
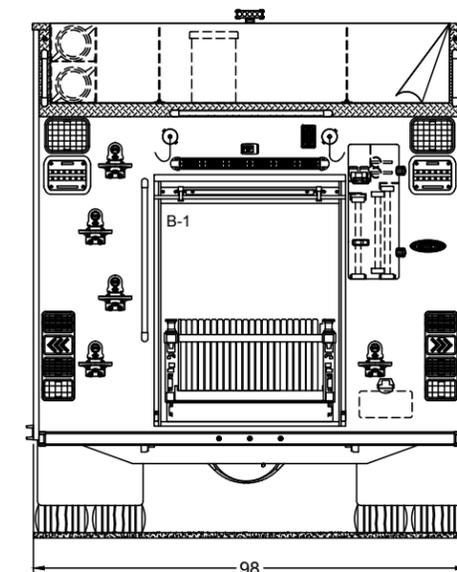


DEEP GAP VOL. FIRE DEPT.

DEEP GAP, NC
 SO.145678 / Q113188
 COMMERCIAL PUMPER
 1500 GPM HALE QMAX-XS PUMP
 1000 GAL WATER
 FREIGHTLINER M2-106 2 DOOR CAB 4X2 CHASSIS

COMPT.	OPENING		INTERIOR DIMENSION			
L1	49W	60.5H	51.5W	70.6H	26 D	
L2	54.5W	27.5H	63.75W	37.6H	26 D	
L3	39.5W	60.5H	42W	70.6H	26 D	
R1	49W	60.5H	51.5W	37.6 H	13.5 D	UPPER
			51.5W	33 H	26 D	LOWER
R2	54.5W	27.5H	63.75W	37.6H	13.5 D	
R3	39.5W	60.5H	42W	37.6 H	13.5 D	UPPER
			42W	33 H	26 D	LOWER
B1	40.5W	51.3H	43W	61.2H	26 D	

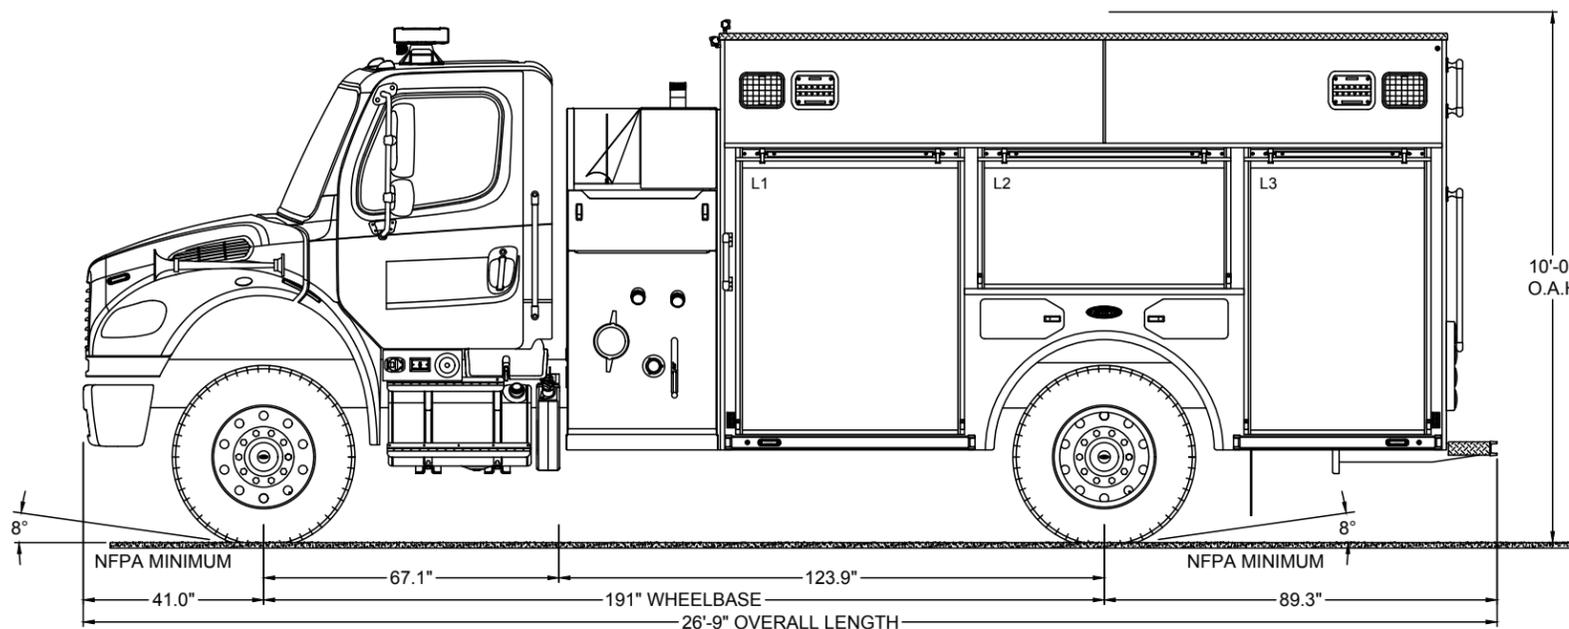

DCALLAGHER	A.1	ORDER REVIEW 1	2022-FEB-25	DCALLAGHER
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
		APPROVAL REVISIONS		SHEET 1 OF 1